


TRENCH WIDTH
IN ACCORDANCE WITH
SECTION 20-2.03
(DISTANCE PIPE TO
TRENCH WALL = 16"
MINIMUM 24" MAXIMUM)


SELECT GRANULAR
TRENCH BACKFILL
REQUIRED IN PAVED
AREAS TO BE
APPROVED BY
APPROPRIATE CITY
OR VILLAGE.

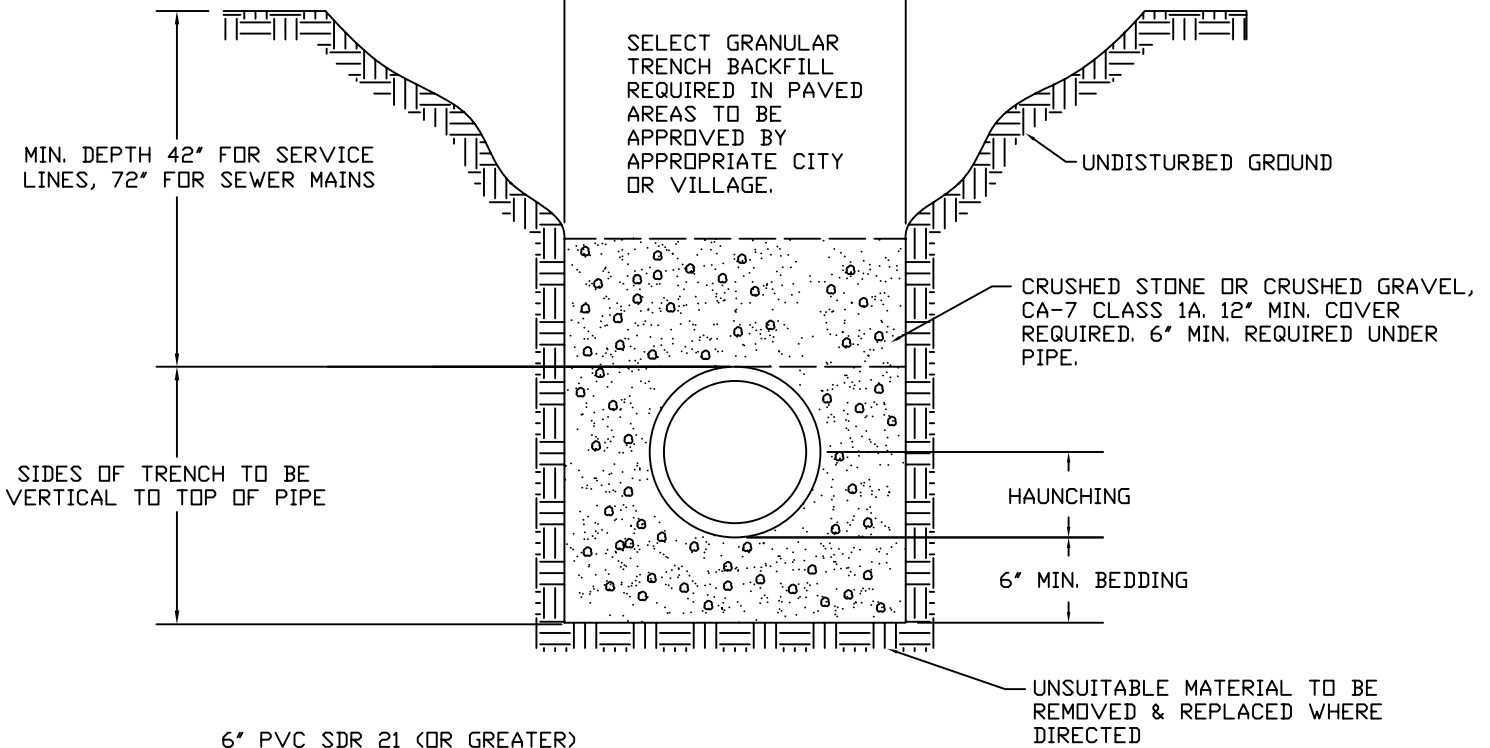

6" PVC SDR 21 (OR GREATER)
PIPE SLEEVE THROUGH THE WALL.

6" PVC SDR 26

4" SCH. 40

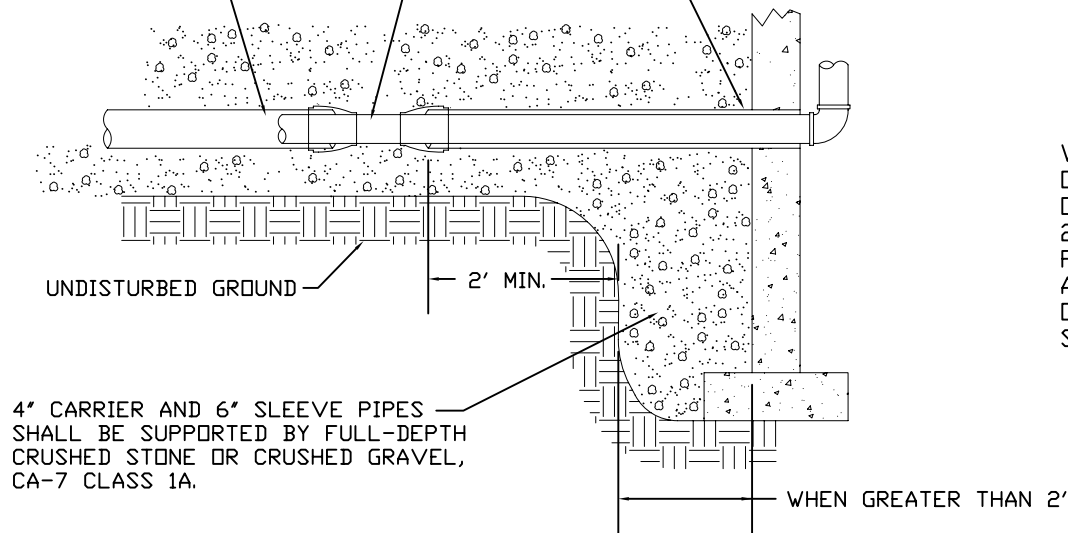

NOTICE

WHEN A SPAN DUE TO AN
OVERDIG AT ANY WALL
OR FOUNDATION EXCEEDS
2', A 6" PVC SDR 21
PIPE SLEEVE SHALL BE
ADDED TO SPAN THE
OVERDIG AREA.
SEE DETAIL AT LEFT.

**TYPICAL TRENCH DETAIL FOR
SANITARY SERVICES & MAINS**

Fox Metro
Water Reclamation District

DESIGNED FMWRD	REVISION	2010
DRAWN KWZ	B Dimension Revision	12/11/01
APPROVED JH	C Revised 2004	01/05/04
DATE 05-12-00	D Stone Note	01/30/06
SCALE NTS	E 07 Revisions	03/19/07
SHEET 1	CAD DWG.	REVISION E
OF 1	JOB NO.	